

## Sticker Label for C-Diff Specimen Collection


**C. diff Specimen Label**

Collected by:  
(Name/unit)

Testing Approved by Dr. Vaclav, Dr. Dakroub  
Dr. Abu Yasin

\*\*\* No approval needed for ER specimens

- Before collecting the stool specimen for C-Diff testing, make sure to follow the algorithm below.

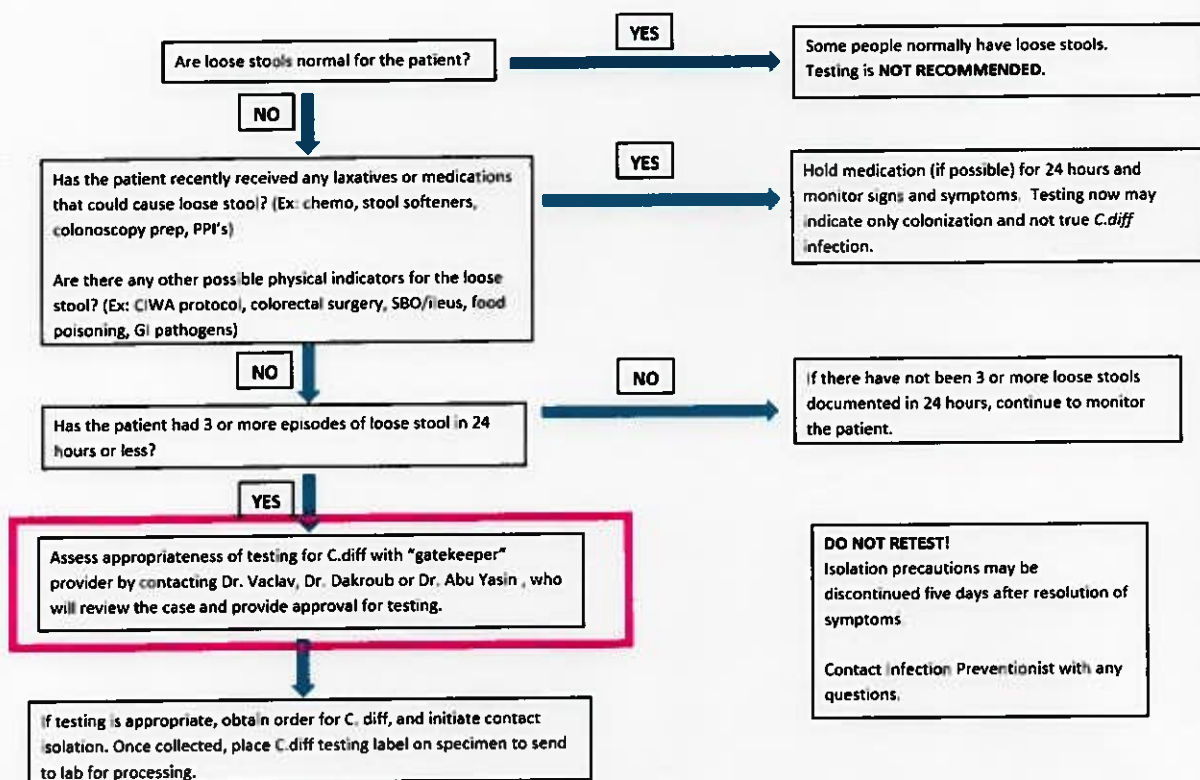

2. Once you have the confirmation that C-Diff testing is appropriate from one of the gatekeeper physicians, attach the sticker label (shown above) on the specimen to be sent to the lab.

3. If there is no sticker attached to the specimen, the lab will contact the Unit to check on the appropriateness of testing.

**\*\* Stickers will be located near the specimen station in every unit.**

**\*\* ER specimens/orders from ER will not require a label, or to be screened through Dr. Vaclav, Dr. Dakroub or Dr. Abu Yasin (this process is for inpatient testing).**