



Transfer to Device

Started

10/13/23

IUH BB



JKS

Besides the Transfer to Device: Changes to Emergency Release SOP

- Added Organ Ox, Attachment has Standard Work if a request for Organ Ox is received
- Changed outdate for Liquid Plasma
 - ALL LP: "Replace by" and the date that is the day before outdating (e.g.
 - if product outdates on 10/30, the replacement date is 10/29).
- No longer add a comment to units when they are moved to Emergency Location/Lifeline or other
 - Now, with this change we will Transfer to a device, or a generic location


When to Transfer to Device

- When preparing blood to be released for
 - Emergency Dispense for the floor
 - Blood or Plasma stored in designated locations outside of the BB
 - ED
 - OR
 - Lifeline

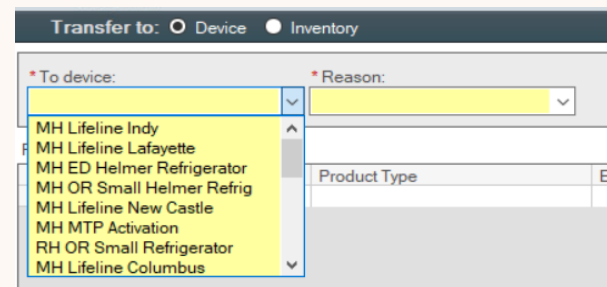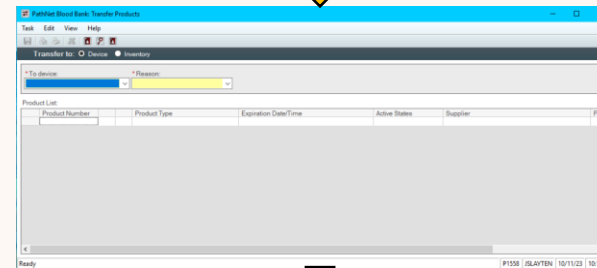

Once in the device location

- Device is like a folder in a file cabinet
- The unit is still in the file cabinet, but now in a specific folder

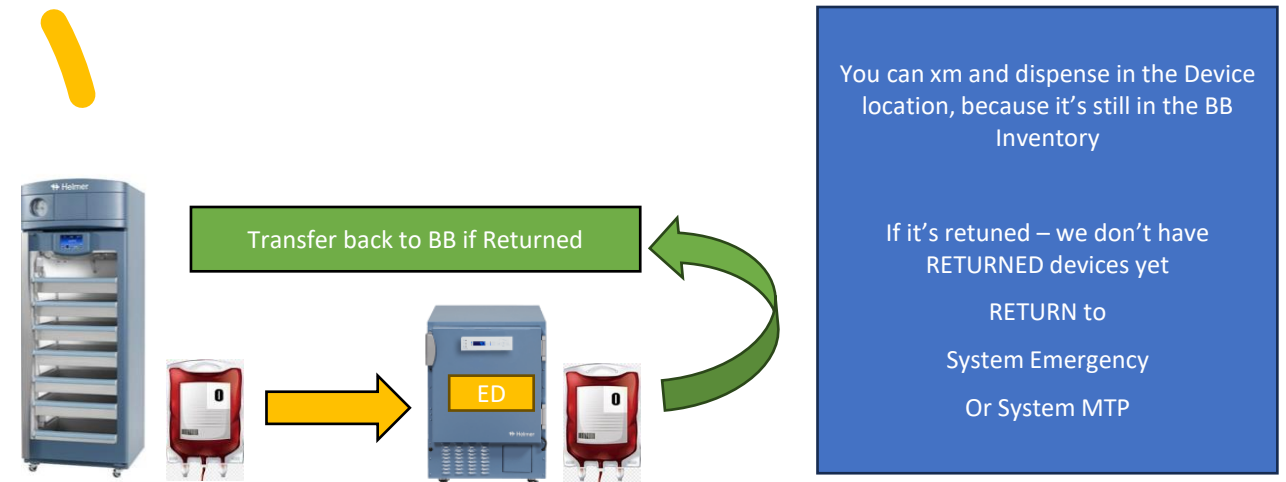


All in the Blood Bank Location

Transfer to the ED Location within the Overall BB Location in Cerner

Paperwork Management

- Pink Emergency Sheets should always have a print out of the transfer to the location
- When you transfer it back, print and attach showing the unit is transferred back to the Inventory
 - This will be helpful for supervisory review to show the unit was returned and placed back into regular inventory.

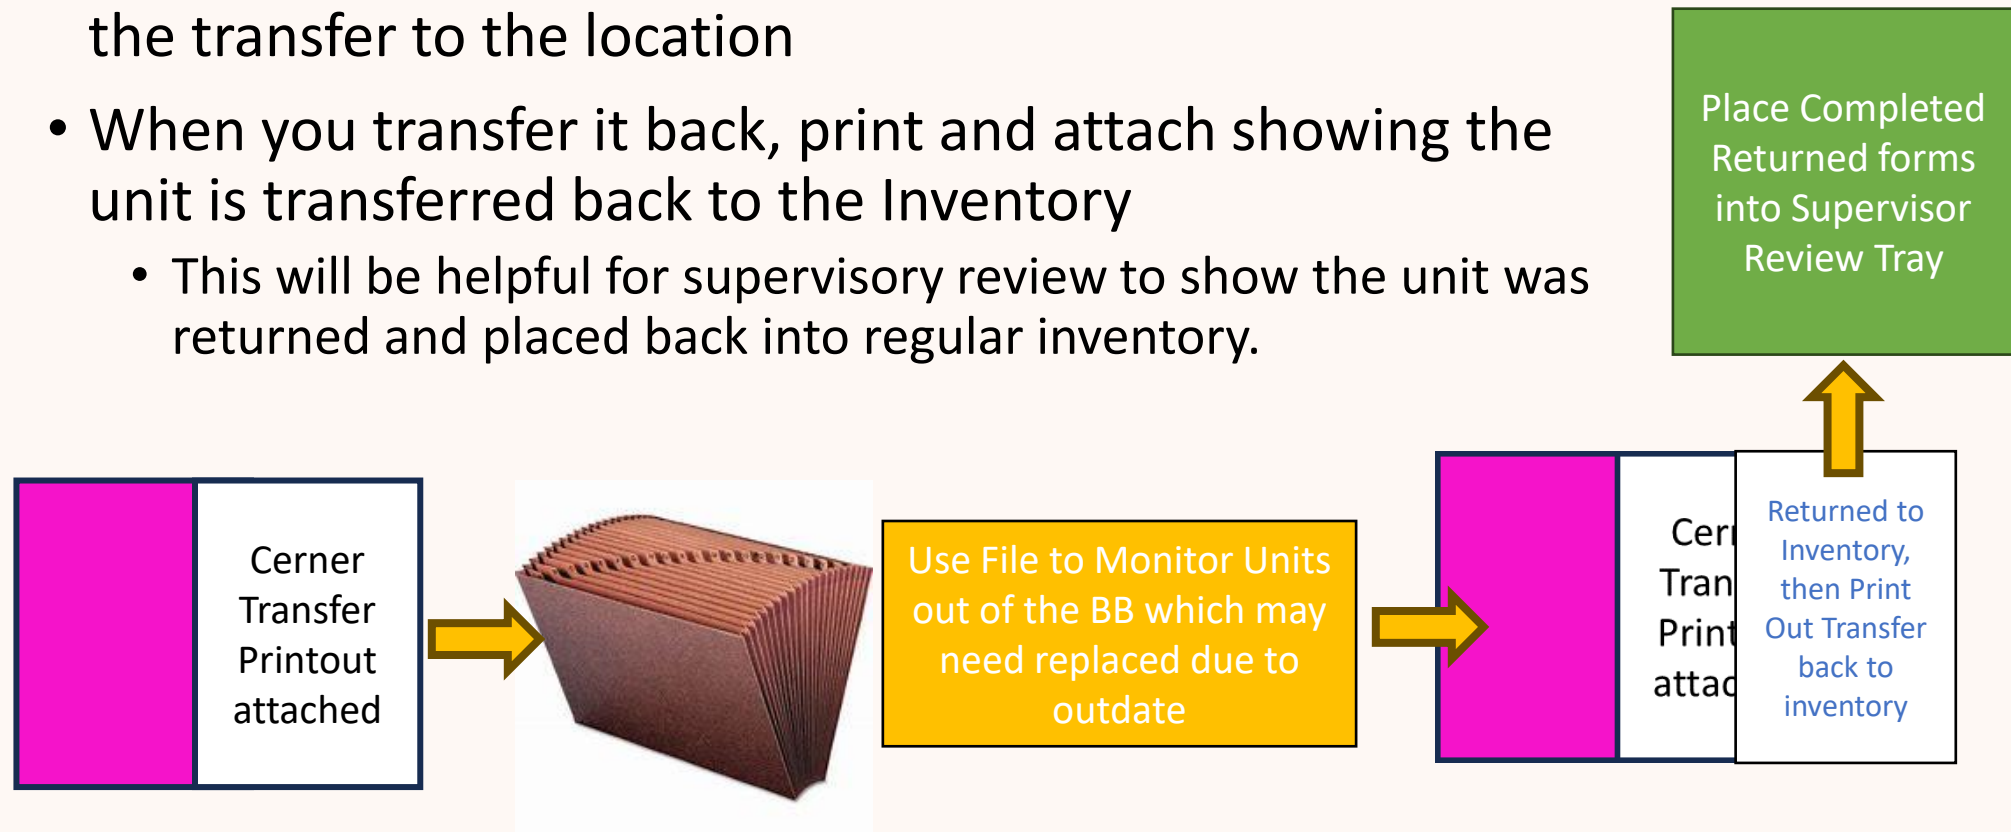

Update to Emergency Release/Transfer Products

- Reminders for this process

- Monitor the PINK forms for outdate and change when appropriate
- Use TP for LP when necessary, if not enough inventory available
- Use the Job Aid for the Outdates of Products – Riley has Special Requirements
- If you forget to print out the Transfer document, then print the Blood Product History showing the transfer to the location.
- Currently – we are only using this process for Emergency Release
- We are not using this process for Massive Transfusion Protocol
 - There are additional changes coming to this process with CPOE, after 10/31/23.